

# MINO 60 high lumen


suspended  
046-42M861GZ



Project / Type

Notes

Count / Date

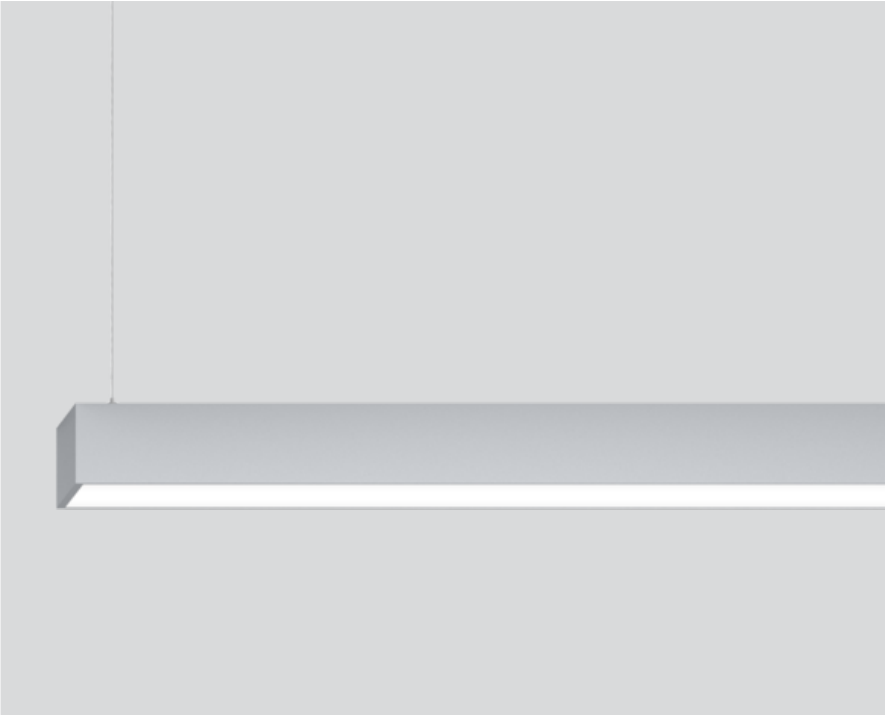

### General

Ceiling | Suspended

white aluminium | RAL 9006

IP20

5470 lm

2330 lm/m

### LED

4000 K

CRI ≥ 80

L90 / 50000 h

initial MacAdam ≤ 3 SDCM

MR 0.72 | MDER 0.65

### Optical

Microprismatic | microprismatic

### Electrical

non DIM

PC1 | 220-240 V

system 45 W

system 122 lm/W <sup>1</sup>

19 W/m

### Physical


cable 1500 mm

length 2352 mm | width 60 mm | height 80 mm


6.5 kg

<sup>1</sup> incl. consideration of optical losses, internal control unit losses & operating device efficiency

### Light distribution



### Product drawing



### Installation instructions



### Lighting calculator



# MINO 60 high lumen

suspended  
046-42M861GZ



Project / Type

Notes

Count / Date

## Maintenance Factors

Operating Time [h]	10 000	20 000	30 000	40 000	50 000
LLMF	0.98	0.96	0.94	0.92	0.9
LSF	1	1	1	1	1
MF	LMF × RSMF × LLMF × LSF		RSMF <sup>a</sup>	Room Surface Maintenance Factor	
MF	Maintenance Factor		LLMF	Lamp Lumens Maintenance Factor	
LMF <sup>a</sup>	Luminaire Maintenance Factor		LSF	Lamp Survival Factor	

<sup>a</sup> According to "CIE 97, Maintenance of indoor electric lighting systems", 2005, ISBN 3-900-734-34-8. The values must be determined by the planner.

## Circuit Breaker Types

Automatic Circuit Breaker Type	Number of Fixtures
B10	15
B13	19
B16	24
B20	30
C10	25
C13	32
C16	40
C20	49

